


Minimum Setbacks  
 Tank to Foundation, PL - 5'  
 Clean Out to Foundation - 3'  
 Drain Field to Tank, PL - 5'  
 Drain Field to Pond - 75'  
 OSSF to Water Line - 10'

Contractor's Notes:  
 1,080 LF of LPD Trenches  
 2' Risers on Trench 1, 7, & 13  
 Min 10" Wide, 18" Deep  
 2) 1250 Gal Septic Tanks  
 2) PL-122 Filters on Outlets  
 1) 1500 Gal Pump Tank  
 Barres BP-314 1/3 Hp Effluent Pump  
 Hydrotek 2110 Timer 24Hr/7D

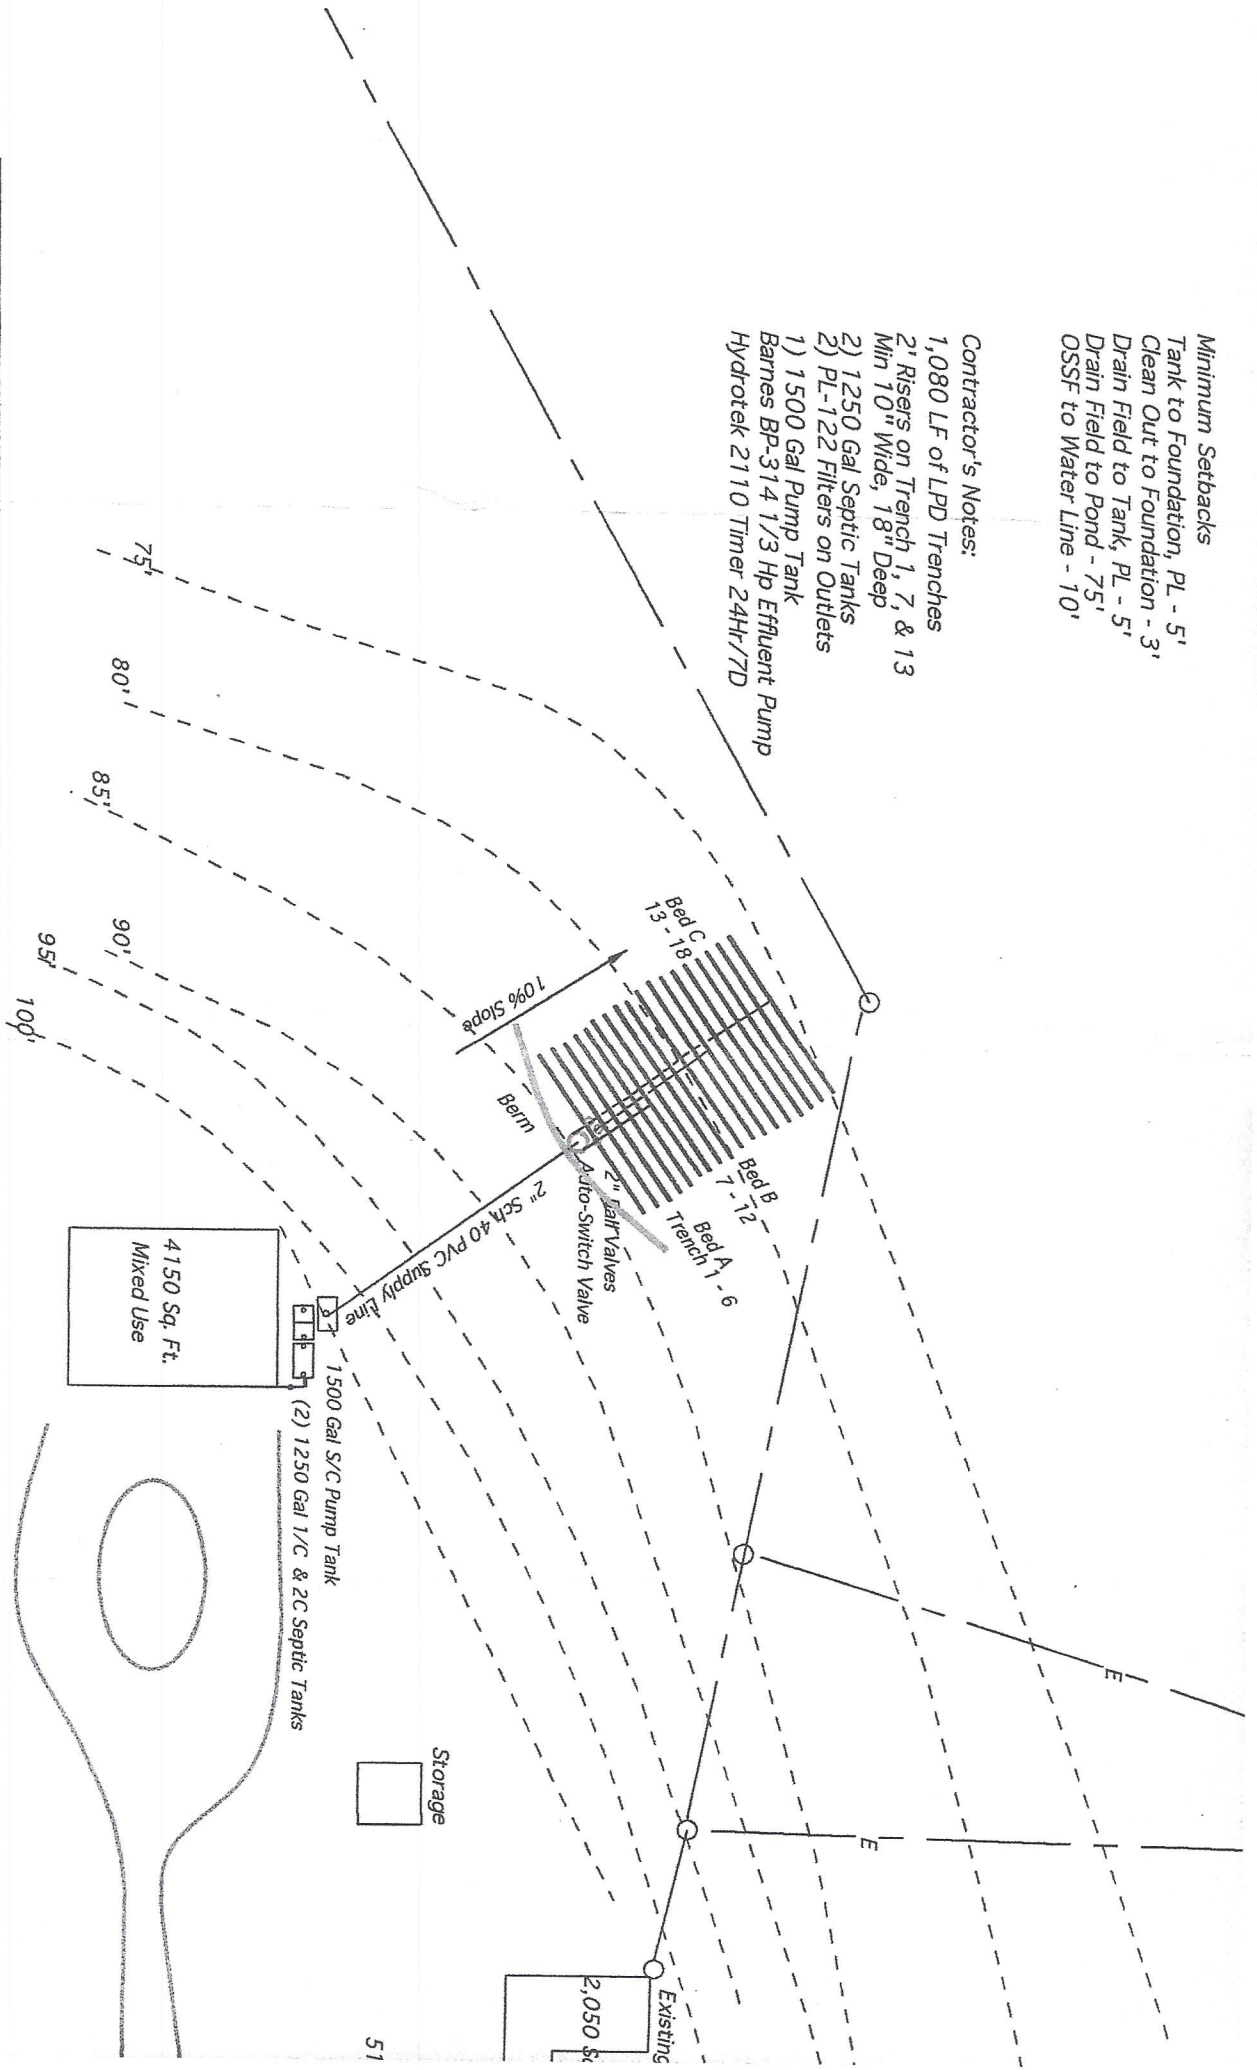

2391.55' Total